




Results of SPUWCD Domestic Well Screening 2009

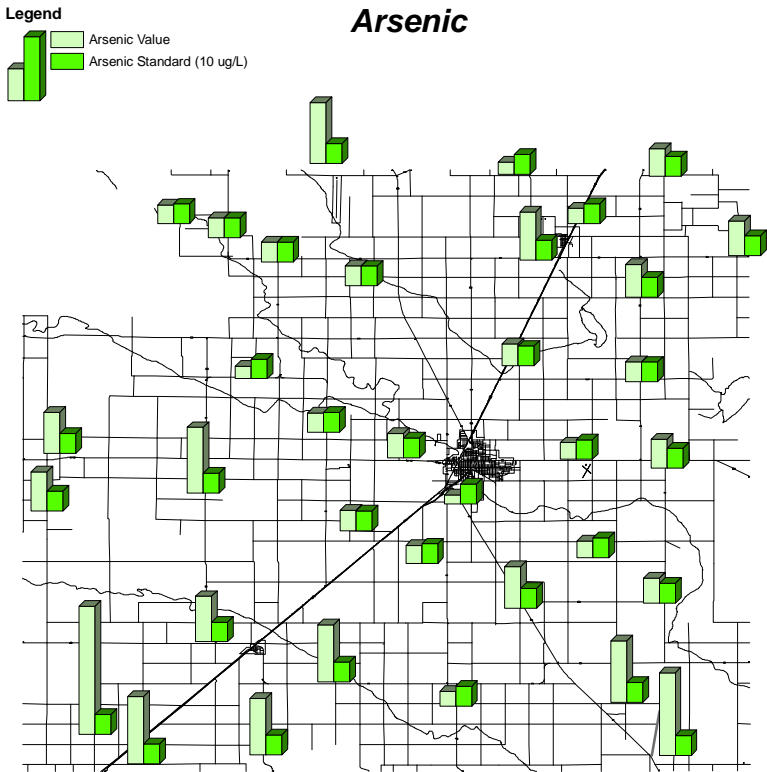


Arsenic Values are represented as ug/L.
Federal drinking water standard for public supplies is 10 ug/L

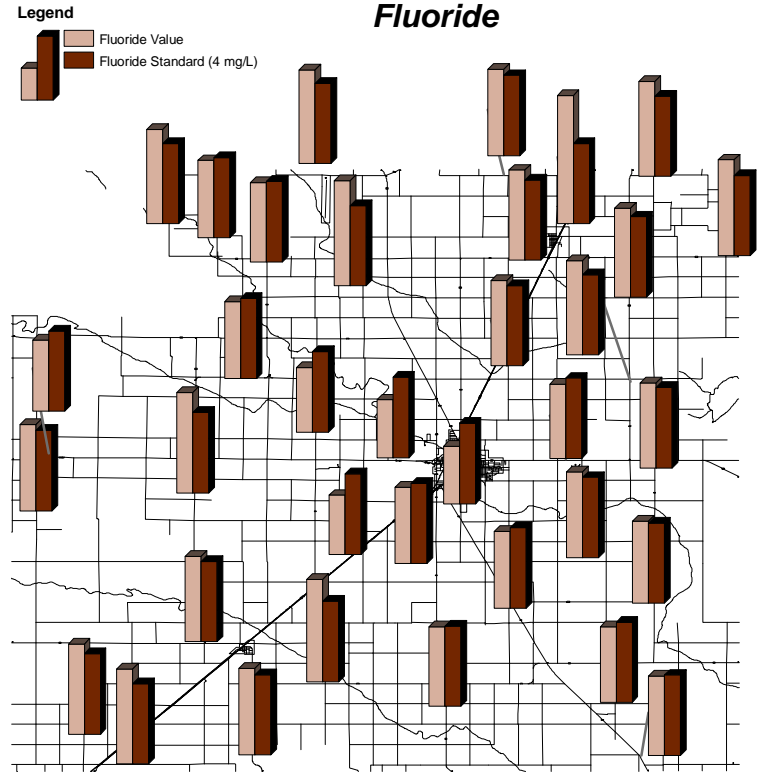

Fluoride Values are represented as mg/L.
Federal drinking water standard for public supplies is 4 mg/L

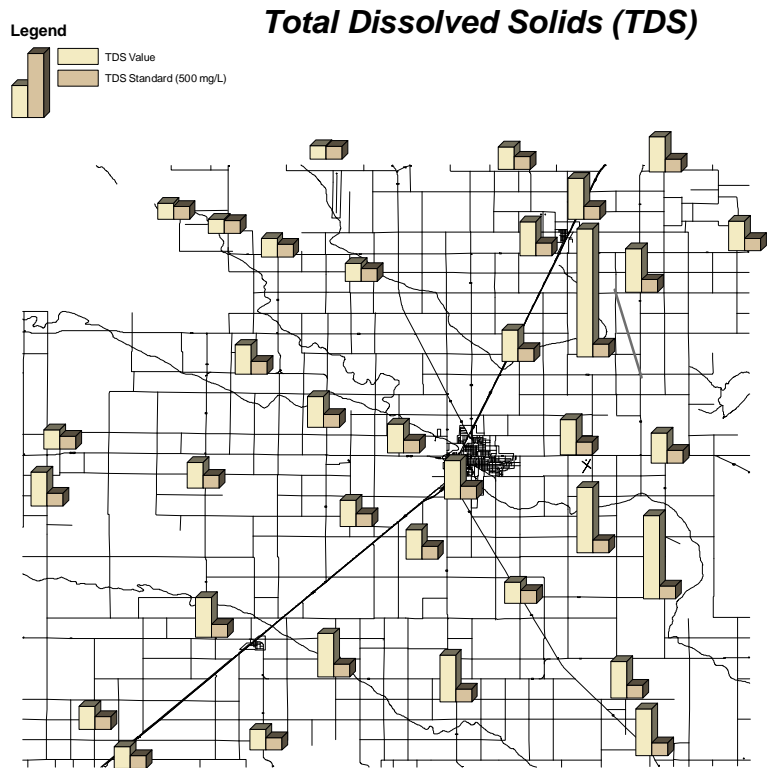

Total Dissolved Solids (TDS) Values are represented as mg/L.
Federal drinking water standard for public supplies is 500 mg/L

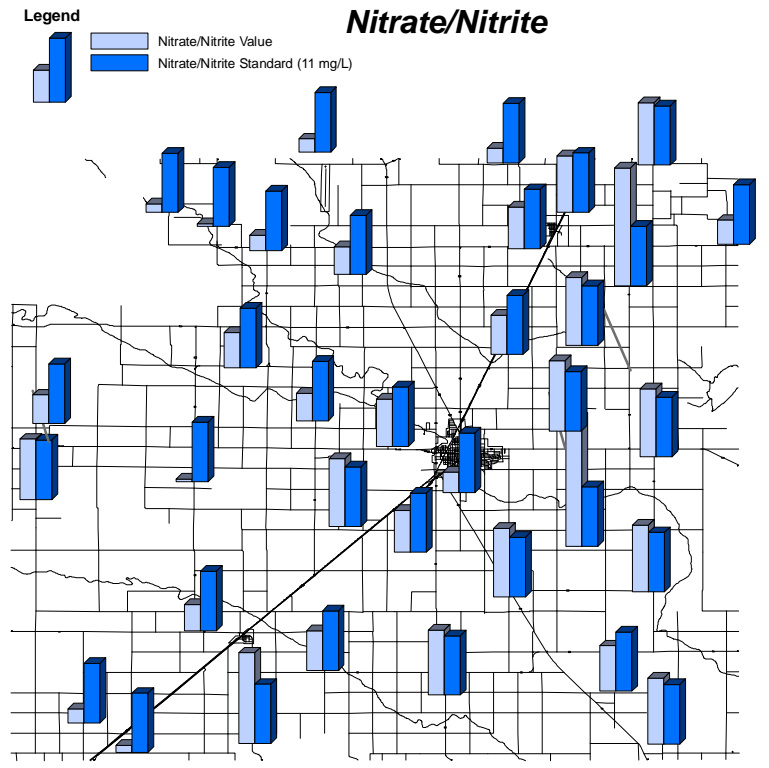

Nitrate/Nitrite Values are represented as mg/L.
Federal drinking water standard for public supplies is 11 mg/L

